


# Concrete pad specification-1000 gallon propane tank

**Pad Length 17'**

**Pad must be at least 6" thick**

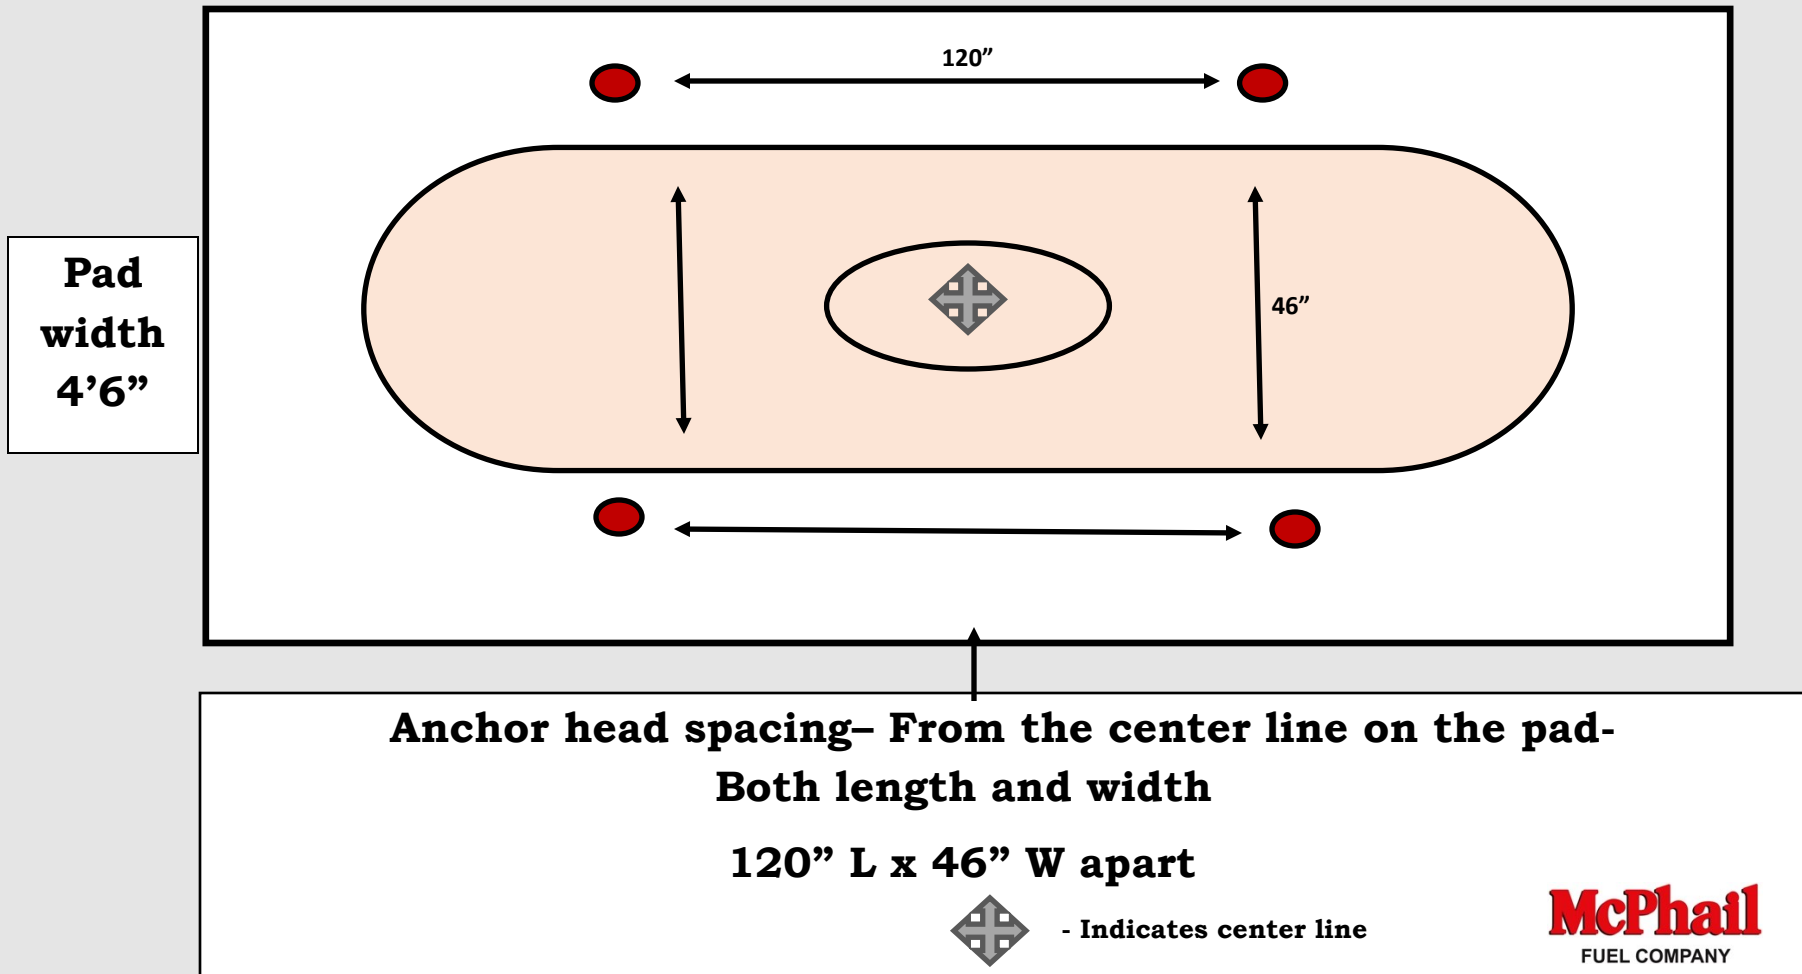

\*Propane tanks can vary in exact size-This pad specification meets the average tank size-Contact office for exact tank specs if required



# TANK ANCHORING

Pour the concrete pad-minimum 6" thick with 1/2" eye bolts set in concrete. The tank will be strapped using a cable & turn-buckle.

