


Concrete pad specification-120 gallon or 420# vertical propane tank



Earthquake valve

Piping goes outside of pad (in ground) on center point

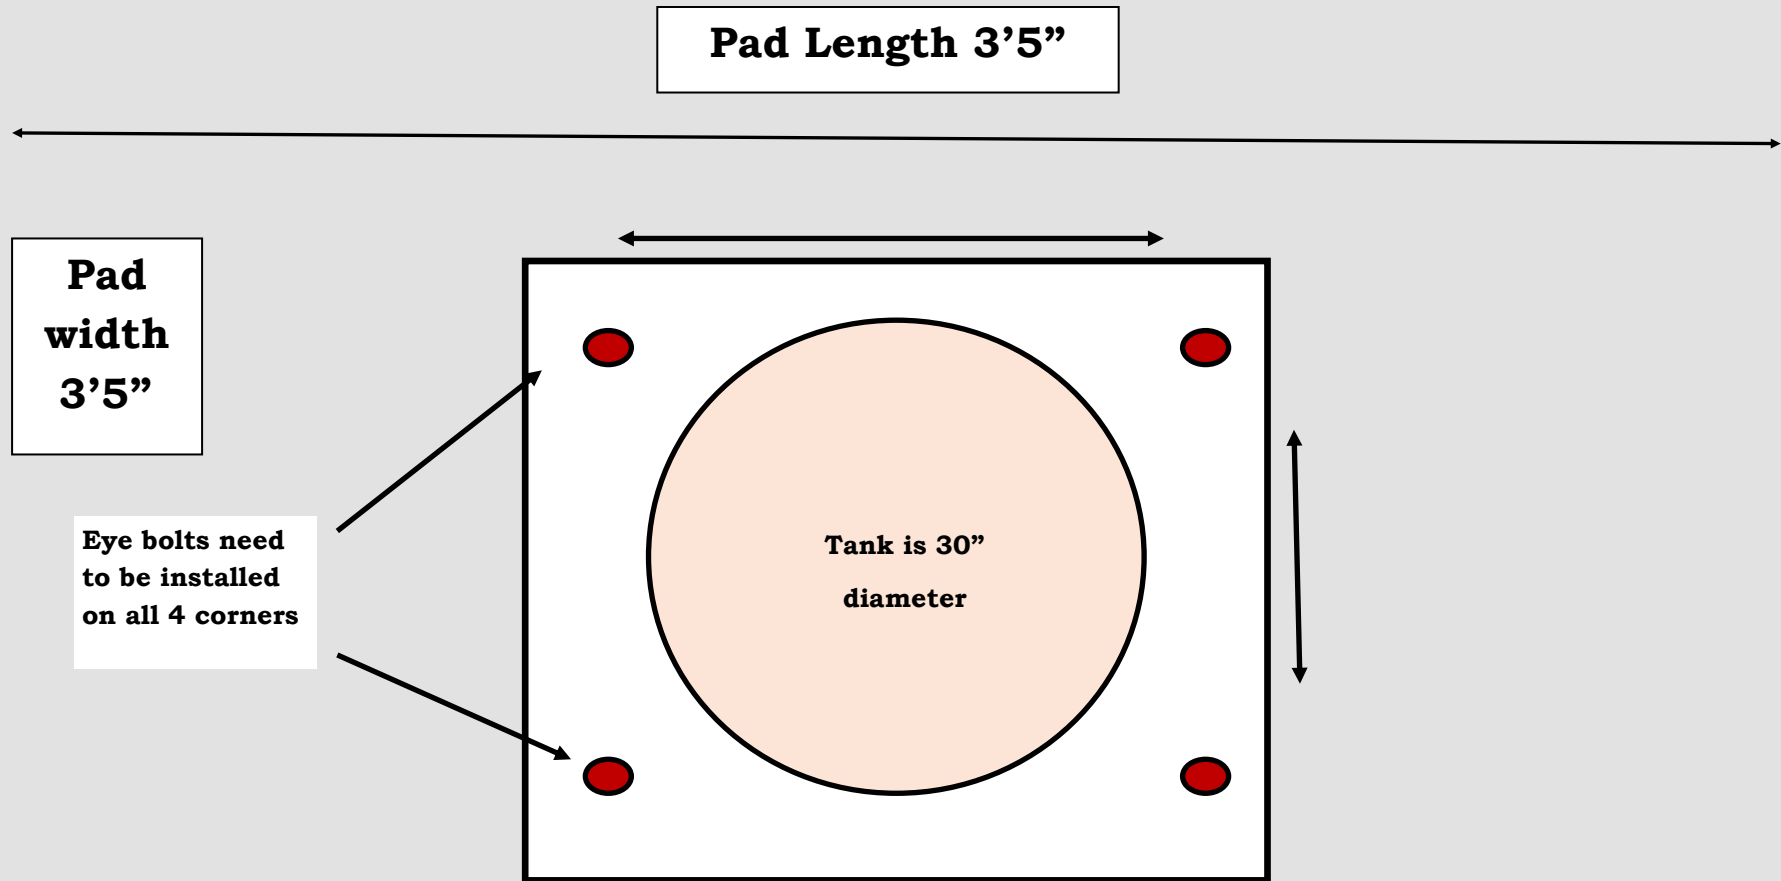

TANK ANCHORING

Pour the concrete pad-minimum 6" thick with 1/2" eye bolts or anchor heads set in concrete. The tank will be strapped using a cable & turnbuckle.

